


Notes:

1. MAIN DISCONNECT PROVIDED BY OTHER.
2. FIELD WIRING TO BE COPPER RATED FOR 75°C MINIMUM.
3. - - - - - INDICATES FIELD WIRING OUTSIDE OF CABINET.
4. ALR-1 & ALR-2 PROGRAM NUMBER: 4107 6004 06

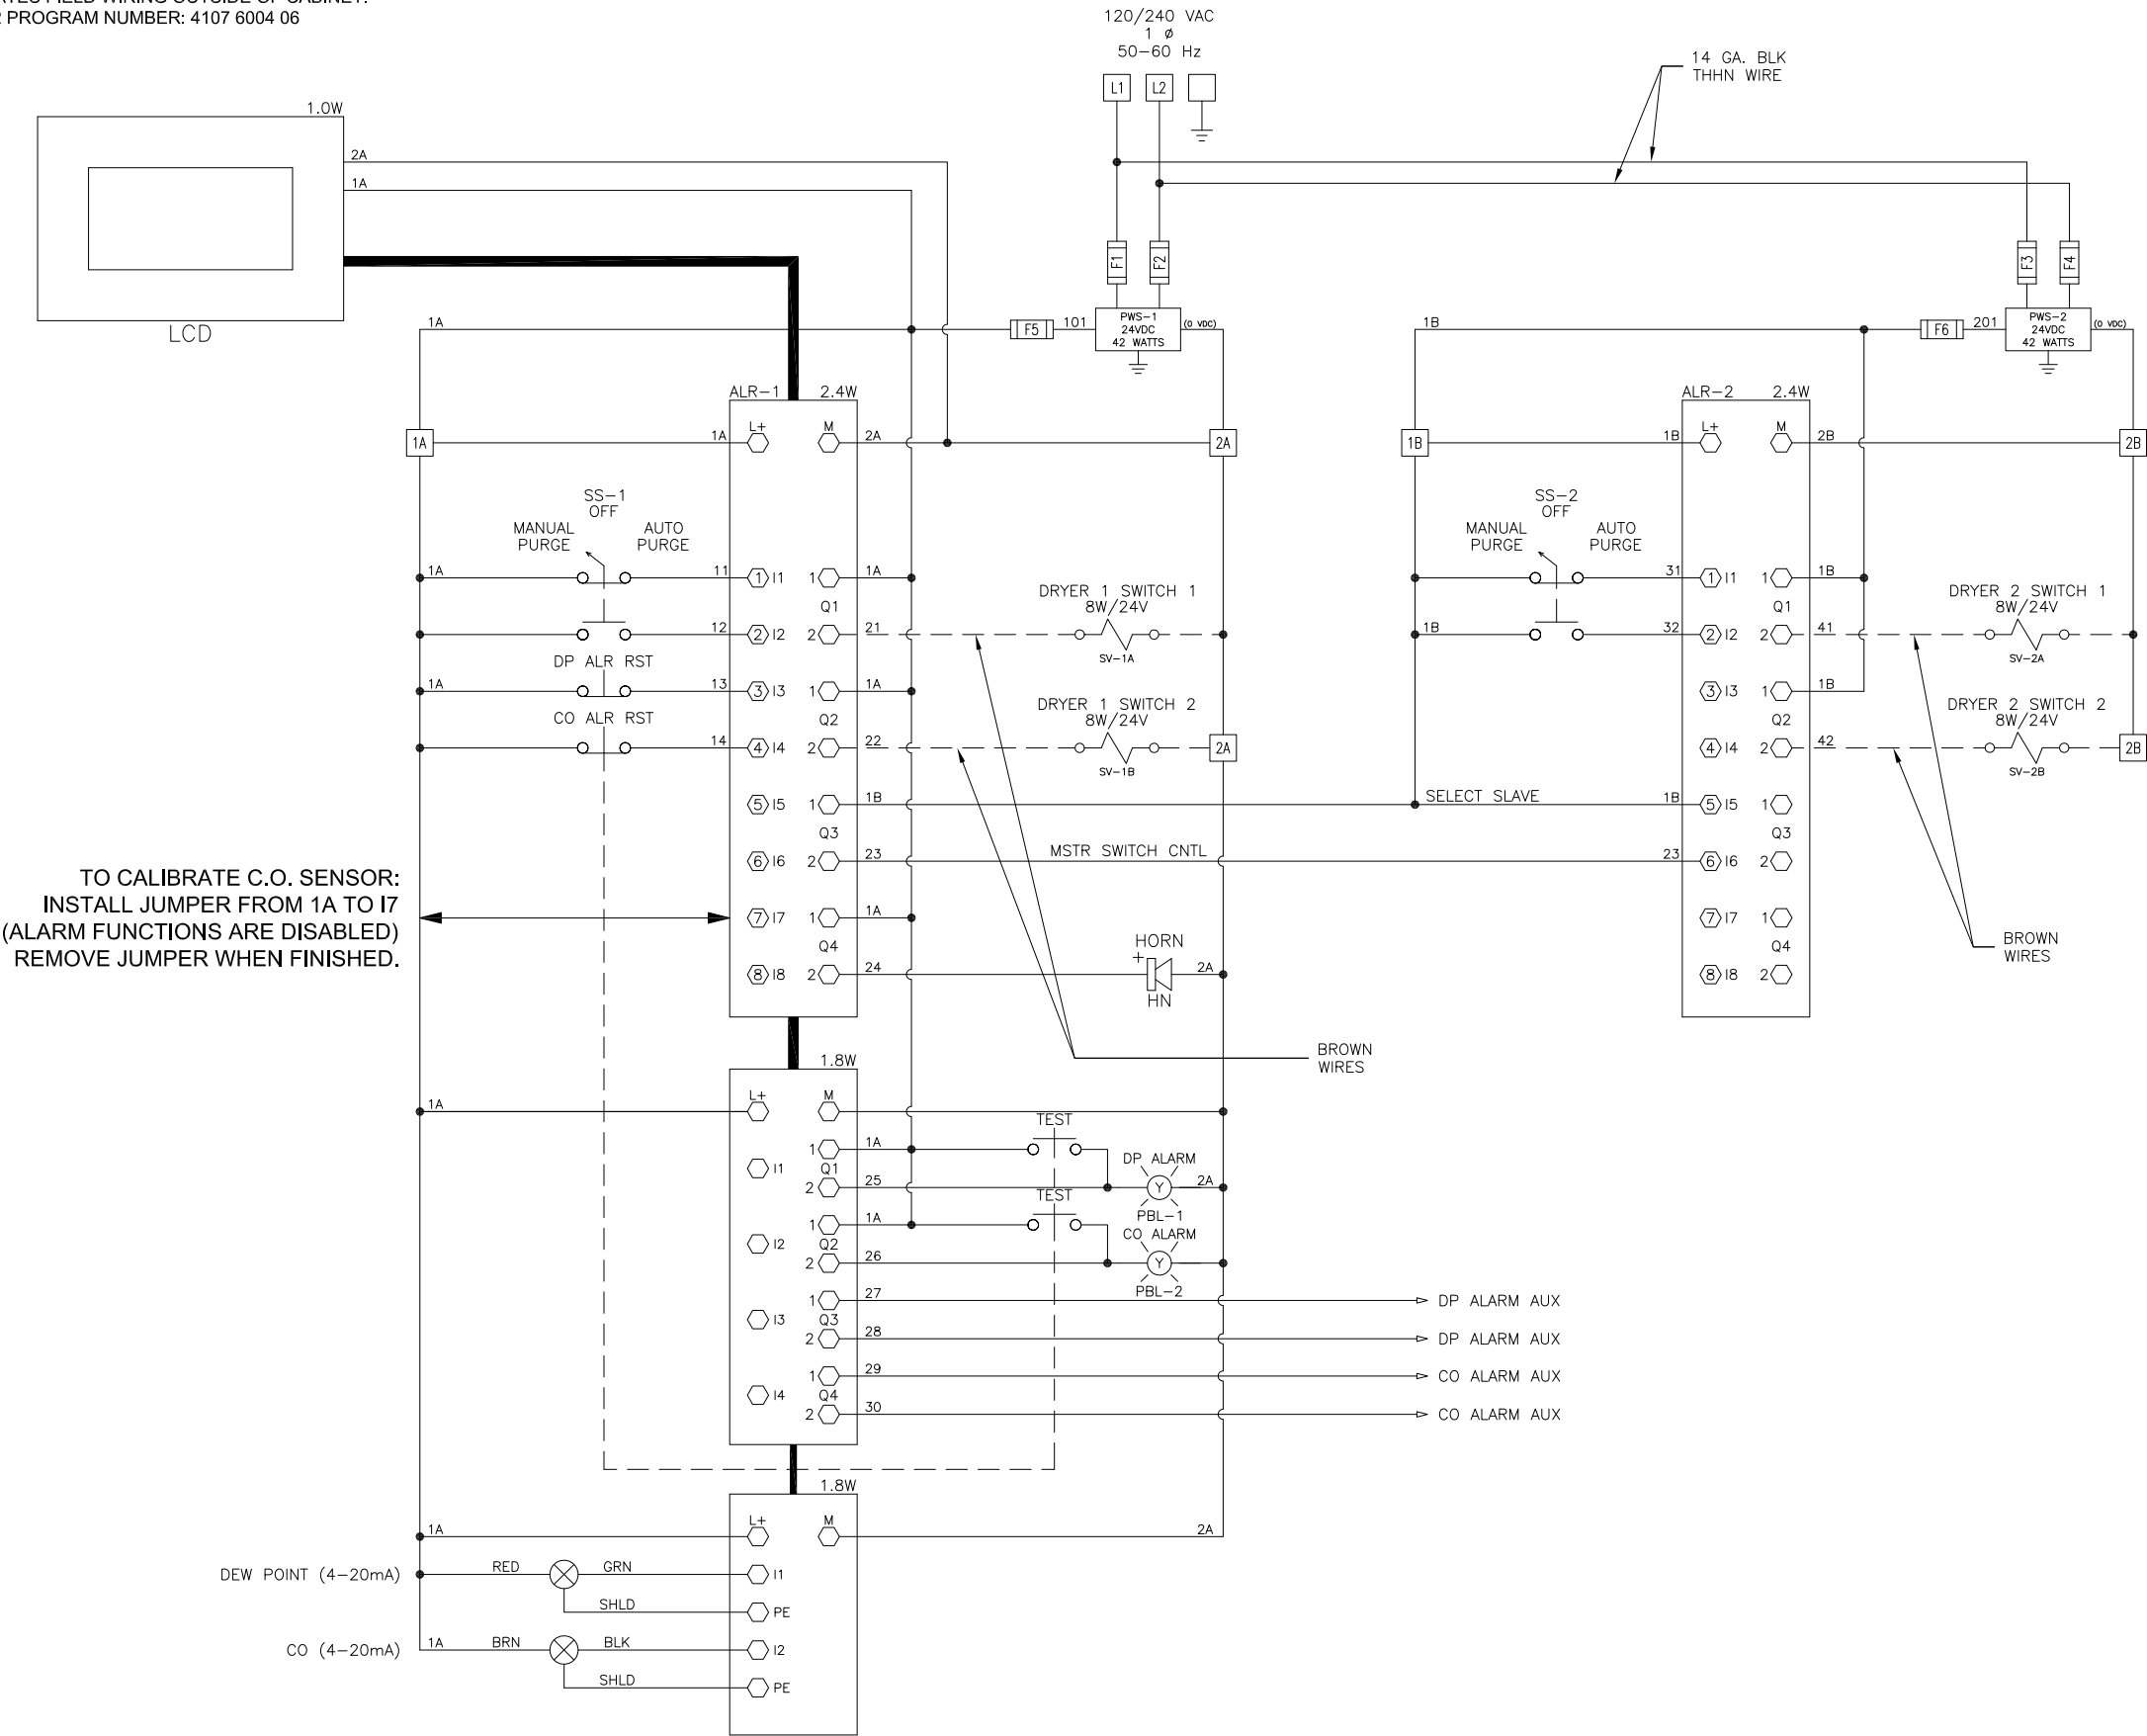

TOTAL SYSTEM FLA	
VOLTAGE	FLA AMPS
120	1.2 AMPS
240	0.6 AMPS

AUXILIARY CONTACTS



CONTACTS CLOSED DURING
NORMAL OPERATION

FUSE SELECTION
(MAX SIZES SHOWN)

FUSE	120V	240V
F1-F4	6.3 AMP	6.3 AMP
F5-F6	1.25 AMP	1.25 AMP

Revised: DAG	Date: 02/02/15	Drawn: DAG	Date: 09/26/13
Description: DWG WIRING CONTROL CD100/300 DRYER - DP & CO 120/240VAC		Part Number: 4107 8548 68	Rev: 01
Sheet 1 of 1		DO NOT SCALE THIS DOCUMENT	